



Standard Practice for Determining Uniformity of Ingredients of Concrete From a Single Source¹

This standard is issued under the fixed designation C 1451; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reapproval.

1. Scope

1.1 This practice covers a procedure for determining the uniformity of properties of concrete materials from a single source. It includes recommendations on sampling, testing, analysis of data, and reporting.

1.2 The values stated in SI units are to be regarded as the standard.

1.3 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

2. Referenced Documents

2.1 ASTM Standards:

- C 125 Terminology Relating to Concrete and Aggregates²
- C 219 Terminology Relating to Hydraulic Cement³
- C 294 Descriptive Nomenclature of Constituents of Natural Mineral Aggregates²
- C 494 Specification for Chemical Admixtures for Concrete²
- C 638 Descriptive Nomenclature of Constituents of Aggregates for Radiation Shielding of Concrete²
- C 917 Test Method for Evaluation of Cement Strength Uniformity from a Single Source³
- D 75 Practice for Sampling Aggregates⁴
- D 3665 Practice for Random Sampling of Construction Materials⁴

3. Terminology

3.1 *Definitions*—For definitions of terms relating to this practice refer to Terminology C 125, Terminology C 219, Descriptive Nomenclature C 294, and Descriptive Nomenclature C 638.

4. Significance and Use

4.1 This practice provides a systematic procedure for sampling and calculating uniformity of concrete materials. It will

measure variability of a property of an ingredient from a single source, over a period of time. The calculation corrects for the effects of testing error. It is applicable to any property of any concrete ingredient. Control of uniformity of concrete relates to controlling or adapting to variability of the ingredients, but this practice does not purport to identify the relative importance of these properties.

5. Sampling

5.1 All sampling is to be performed by Quality Control or testing personnel specifically trained for this purpose.

5.2 Take random grab samples from a point in the storage and handling regime of the material that will accurately reflect the uniformity of the material as it will be used in concrete. Practice D 3665 provides general guidance. Additional guidance for specific materials is listed in 5.2.1-5.2.4. The lot size from which a sample is taken shall be determined prior to initiation of this procedure (Note 1). Identify samples by the date on which the material was shipped or received, its source, and designated type and applicable specifications.

NOTE 1—A lot is defined as the quantity in a typical delivery unit, for example, a 25-ton truck of aggregate or a 100-ton railroad car.

5.2.1 Sample cement in accordance with Test Method C 917.

5.2.2 Sample fine and coarse aggregates in accordance with Practice D 75.

5.2.3 Sample chemical admixtures in accordance with Specification C 494.

5.2.4 Sample mineral admixtures in accordance with Practice C 917.

5.3 The required sampling frequency depends on how the data are being used. A producer might reasonably sample relatively frequently, for example, every production lot or day's production. A user might be interested in uniformity of a material over a longer time frame, for example, approximately representing the frequency of purchase for a particular application. These two sampling frequencies might indicate different levels of uniformity, therefore, it is important that the sampling program used be described in the report (Section 8).

6. Procedure

6.1 *General*—Test all samples in accordance with the appropriate ASTM Test Method for the particular property being

¹ This practice is under the jurisdiction of ASTM Committee C-9 on Concrete and Concrete Aggregates and is the direct responsibility of Subcommittee C09.94 on Evaluation of Data.

Current edition approved Dec. 10, 1999. Published February 2000.

² *Annual Book of ASTM Standards*, Vol 04.02.

³ *Annual Book of ASTM Standards*, Vol 04.01.

⁴ *Annual Book of ASTM Standards*, Vol 04.03.

measured. Variation within a single source is estimated by first calculating total variation from test data on grab samples, and then correcting this by subtracting variation inherent in the test method (testing error). Best results are obtained if all tests are conducted in the same laboratory, but guidance is provided if it is necessary to use data from more than one laboratory.

6.2 *Total Variation*—Test all samples in accordance with the appropriate ASTM Standard Test Method for the particular test property being measured. Calculate the total variation among the samples, as directed in 7.1.2.

6.3 *Testing Error*—Testing error is comprised of components due to within-laboratory variation and between-laboratory variation. If results are obtained from only one laboratory, then between-laboratory variation makes no contribution. If data are obtained from more than one laboratory, it is preferable to keep data from each one separate during data analysis, pooling estimates of parameters at the end of the analysis.

6.3.1 If no within-laboratory testing standard deviation history has been established, duplicate tests made from a single sample are required to determine this parameter. Samples must be tested in duplicate on different days until at least ten samples have been tested in duplicate. Calculate the standard deviation and the coefficient of variation, as outlined in 7.1.3 and 7.1.4. If the testing error exceeds the level of error reported in the precision statement for the applicable test method, but is less than 1.5 times this value, continue duplicate tests at this same rate. When the testing error is equal to or below the testing error reported in the precision statement, reduce the frequency of duplicate testing. If the testing error exceeds 1.5 times the testing error reported in the precision statement, the data is of unacceptable precision, and the laboratory procedure and equipment should be thoroughly examined. Use the results of duplicate tests, indicating acceptable precision to estimate the single laboratory testing variation for all other types of similar materials tested in that laboratory during the same period of time, provided that duplicate tests have been made on a least one sample per month.

6.3.2 When two or more laboratories are used to evaluate the uniformity of a source, then additional tests of a standard sample or exchanged portions of the same sample may be necessary to determine differences in testing that are likely to be obtained in the different laboratories. When two laboratories exchange portions of the sample and run single tests, results from the laboratories shall not differ by more than the multi-laboratory precision (D2S value) of the average of the two laboratories. If a larger number of samples are exchanged, then the difference between laboratories exceed the D2S no more than 5 % of the time.

6.4 *Single-Source Variation*—Calculate single-source variation according to 7.1.5.

7. Calculation

7.1 The calculations shall include the following (Note 2):

NOTE 2—Values for averages and standard deviations can be calculated

by other methods that are available in MNL 7 (STP 150).⁵ Electronic calculators are available for obtaining these statistics directly.

7.1.1 *Average Measurement*:

$$\bar{x} = \frac{x_1 + x_2 + \dots + x_n}{n} \quad (1)$$

where:

\bar{x} = average measurement,
 x_1, x_2, \dots, x_n = individual measurements, and
 n = number of individual tests.

7.1.2 *Standard Deviation*:

$$s = \sqrt{\left[\frac{(x_1 - \bar{x})^2 + (x_2 - \bar{x})^2 + \dots + (x_n - \bar{x})^2}{(n - 1)} \right]} \quad (2)$$

where:

s = standard deviation in units of measurement.

7.1.3 *Testing Error*: The standard deviation in testing is calculated as follows:

$$s_e = \sqrt{\frac{\sum d^2}{2k}} \quad (3)$$

where:

s_e = standard deviation estimated from tests of duplicate measurements made in a single laboratory from the sample,

d = difference between duplicate determinations, and

k = number of sets of duplicate determinations.

7.1.4 *Coefficient of Variation*: The coefficient of variation for testing is calculated as follows,

$$CV(\%) = \frac{s_e}{\bar{x}} \cdot 100 \quad (4)$$

7.1.5 *Single-Source Standard Deviation*:

Standard deviation of material from a single source, corrected for testing error is calculated as follows:

$$s_c = \sqrt{s^2 - s_e^2} \quad (5)$$

where:

s_c = standard deviation corrected for testing error,

s = standard deviation for all tests included in the calculation, and

s_e = standard deviation of duplicate tests run on split samples to evaluate testing error.

8. Report

8.1 Sufficient information shall be provided to identify the material sampled including the following:

8.1.1 Name of manufacturer and location,

8.1.2 Classification or type of material,

8.1.3 Location of sampling,

8.1.4 Laboratory designation,

8.1.5 Period of time represented by the report, and

8.1.6 Description of sampling frequency.

8.2 For ongoing programs, the minimum period covered by the report shall include all tests made in the preceding three months, but in no instances less than that period of time necessary to include 20 consecutive samples.

⁵ *Manual on Presentation of Data and Control Chart Analysis, MNL7 (STP 150)*, 6th edition, ASTM.

8.2.1 The report shall not cover a period of time greater than one year or tests of more than 120 samples.

8.3 The report of results shall be either in tabular form as shown in Table 1, or in graphical form as shown in Fig. 1, at the option of the reporting organization (Note 3).

NOTE 3—For purposes of analyzing trends, the graphical presentation is to be preferred. The average and standard deviation, as calculated in Section 7, shall be shown.

8.4 Report the results of duplicate tests on the same sample within the period covered by the report. When duplicate tests

are made from samples other than that being tested during the same period of time, by the same laboratory, these test results will not normally be reported on a regular basis, but results of such tests will be made available upon request. However, report the testing standard deviation.

8.5 The report shall include the following values calculated from the reported data. Each sample shall be represented only by a single result in these calculations. The second of a pair of duplicate test results shall not be included in the overall calculation, but shall be used only to establish testing error.

TABLE 1 Sample Uniformity Test Report

NOTE 1—This example includes additional information, beyond that necessary for reporting, for purposes of illustrating the calculation of testing error (see columns with **bold-face** type).

ABC Cement, Inc., Qualitytown Type I, sampled on truck loading at Qualitytown ABC Qualitytown Laboratory										
Date Represented: 2/4/76 - 5/24/76		7 Day				28 Day				
Average Strength, Mpa		26.77				33.12				
Standard Deviation		1.05				1.39				
number of samples		37				30				
Testing Standard Deviation		0.90				0.97				
number of duplicates		13				10				
Corrected Standard Deviation		0.53				1.00				
Date Shipped	Sample Number	7-Day Strength Determination				28-Day Strength Determination				
		Repl a	Repl b ^A	d ^B	Average 5	Repl a	Repl b ^A	d ^B	Average 5	
2/4/76	1	26.08	26.89	-0.81	...	34.81	32.98	1.83	...	
2/9/76	2	26.66	33.43	
2/11/76	3	27.58	28.38	-0.8	...	34.93	33.78	1.15	...	
2/12/76	4	27.46	34.47	
2/17/76	5	27.8	27.12	33.32	34.19	
2/18/76	6	26.08	26.54	-0.46	27.12	31.25	32.29	-1.04	33.48	
2/19/76	7	26.77	27.14	31.94	33.18	
2/23/76	8	26.89	27.00	32.51	32.70	
2/24/76	9	27.11	27.92	-0.81	26.93	33.89	34.24	-1.38	32.58	
2/25/76	10	24.82	26.33	30.34	31.99	
3/2/76	11	25.17	26.15	32.41	32.22	
3/3/76	12	27.81	26.08	1.73	26.36	32.06	32.17	-0.11	32.24	
3/4/76	13	26.2	26.22	32.41	32.22	
3/8/76	14	25.62	25.92	31.48	31.74	
3/9/76	15	28.5	24.93	3.57	26.66	35.05	33.21	1.84	32.68	
3/10/76	16	26.54	26.93	35.62	33.32	
3/15/76	17	25.39	26.45	32.66	33.44	
3/16/76	18	24.93	26.20	31.96	33.35	
3/17/76	19	27.58	27.58	0	26.59	33.44	34.01	-0.57	33.75	
3/22/76	20	27.81	26.45	34.93	33.72	
3/23/76	21	27.81	26.70	35.27	33.65	
3/24/76	22	27.23	27.69	-0.46	27.07	32.52	34.36	-1.84	33.62	
3/29/76	23	27.12	27.51	33.67	33.97	
4/5/76	24	24.82	26.96	32.17	33.71	
4/6/76	25	27.92	28.84	-0.92	26.98	33.89	33.09	0.8	33.50	
4/12/76	26	26.08	26.08	0	26.63	32.17	33.98	-1.81	32.88	
4/12/76	27	27.58	26.70	33.44	33.07	
4/19/76	28	27.12	26.70	32.75	32.88	
4/20/76	29	28.03	27.35	34.01	33.25	
4/28/76	30	26.08	26.98	30.68	32.61	
5/3/76	31	24.82	24.93	-0.11	26.73	
5/6/76	32	28.03	26.82	
5/7/76	33	27.11	27.58	-0.47	26.81	
5/12/76	34	27.46	26.70	
5/17/76	35	26.77	26.84	
5/18/76	36	26.08	27.46	-1.38	27.09	
5/24/76	37	27.61	27.01	
Average		26.77	Sum d²	21.10	Average		33.12	Sum d²	18.68	
Std Deviation		1.05	2k	26	Std Deviation		1.39	2k	20	
			Testing Std Dev	0.90				Testing Std Dev	0.97	

^A replicate b values are not included in the averages of five. See 8.5.

^B difference between replicates a and b

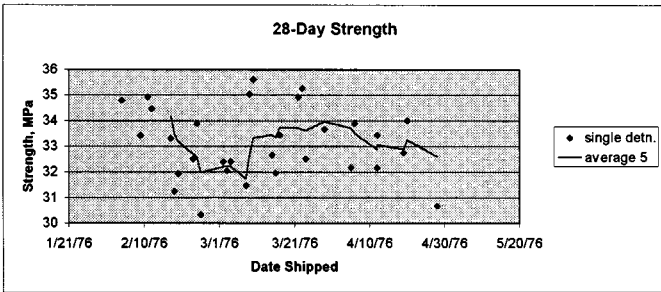
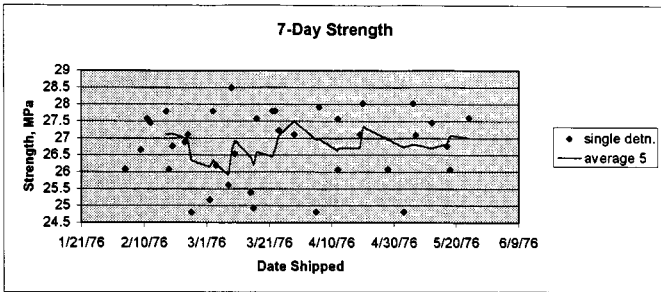


FIG. 1 Data Plots, Uniformity Test Report

(See Footnote A of Table 1.)

8.5.1 Calculate from the reported data:

8.5.1.1 \bar{x} = the average,

8.5.1.2 s = the standard deviation,

8.5.1.3 s_e = testing standard deviation,

8.5.1.4 n = the number of samples tested,

8.5.1.5 s_c = the standard deviation corrected for testing, and

8.5.1.6 x_5 = the moving averages of the five most recent results.

8.5.2 The calculations shall not be made and reported until five results are available. The moving average of the five most recent results should be updated with each successive result by adding the new value in the calculation and deleting the oldest previous value (see Table 1).

8.5.3 Whenever the reporting agency concludes that a consistent change in properties has occurred, at its option, it may discontinue calculation until results from five additional samples have been obtained. In this instance, the values calculated from samples prior to the change shall also be reported.

8.5.4 When there is a break in the calculation, the sampling dates included in each set of calculated values shall be clearly identified.

9. Keywords

9.1 concrete materials; uniformity

The American Society for Testing and Materials takes no position respecting the validity of any patent rights asserted in connection with any item mentioned in this standard. Users of this standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, are entirely their own responsibility.

This standard is subject to revision at any time by the responsible technical committee and must be reviewed every five years and if not revised, either reapproved or withdrawn. Your comments are invited either for revision of this standard or for additional standards and should be addressed to ASTM Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee, which you may attend. If you feel that your comments have not received a fair hearing you should make your views known to the ASTM Committee on Standards, at the address shown below.

This standard is copyrighted by ASTM, 100 Barr Harbor Drive, PO Box C700, West Conshohocken, PA 19428-2959, United States. Individual reprints (single or multiple copies) of this standard may be obtained by contacting ASTM at the above address or at 610-832-9585 (phone), 610-832-9555 (fax), or service@astm.org (e-mail); or through the ASTM website (www.astm.org).